

NorSef_m.722

22-Mar-2010

code revision: 3313

/haitasj/manuscripts/errorMonitoringBySpikeSynchronyInSupplementaryEyeField

Electrodes

DSP01

Units

a,b

Alignments




Saccade_

Trial Types

GOCorrect

NOGOWrong

NorSef_m.722
 Pair: 01a, 01b
 Trial Type: GOCorrect
 Number of Trials: 791
 Target Locations: 1 2
 Bin Width: 13ms
 Coin Width: +/- 130ms

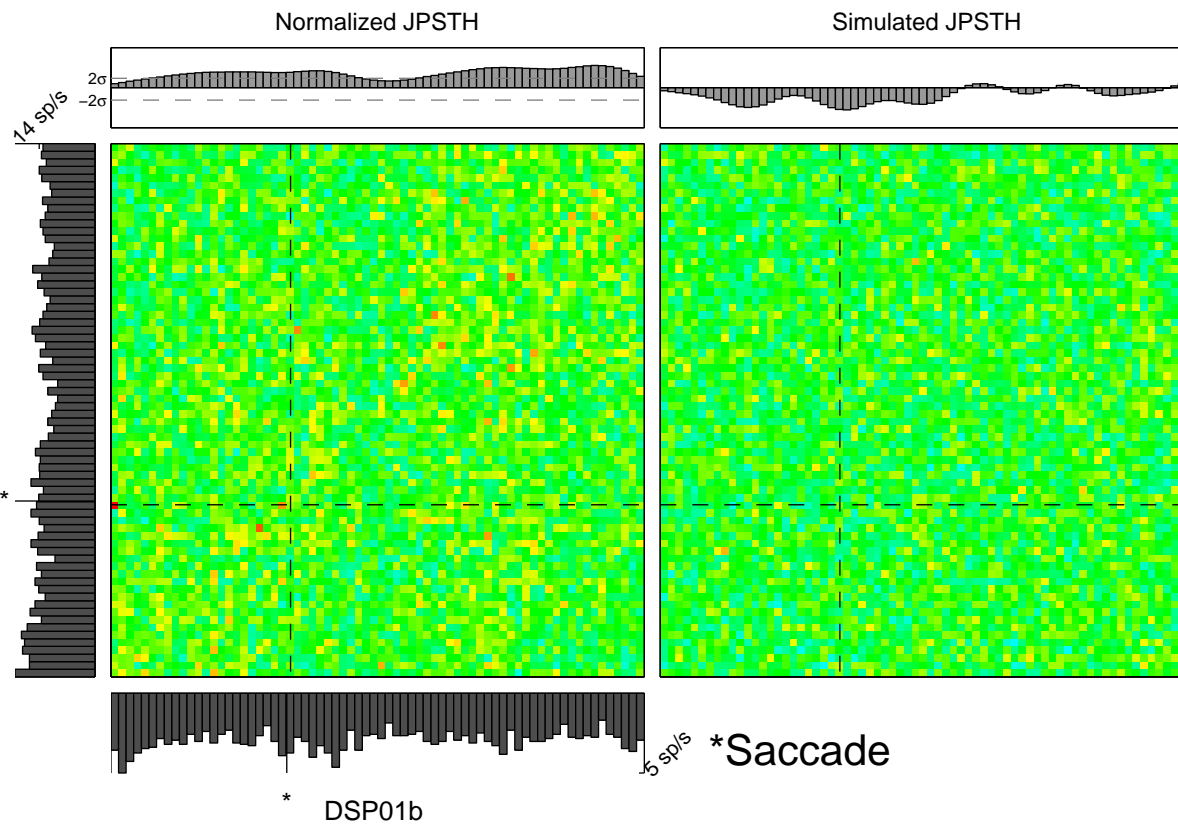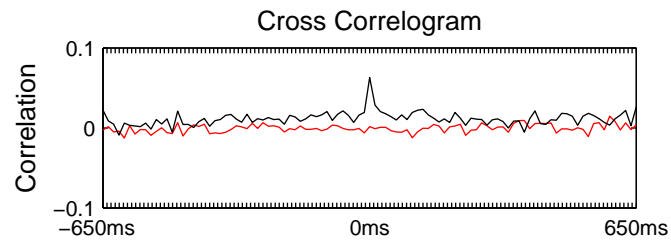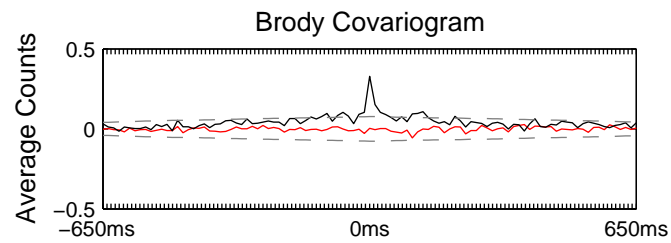

-300ms

2 610ms

22-Mar-2010 - r3313

NorSef_m.722
 Pair: 01a, 01b
 Trial Type: NOGOWrong
 Number of Trials: 48
 Target Locations: 1 2
 Bin Width: 13ms
 Coin Width: +/- 130ms

