

NorSef_m.356

31-Mar-2010

code revision: 3372

/haitasj/manuscripts/errorMonitoringBySpikeSynchronyInSupplementaryEyeField

Electrodes

DSP01

Units

a,b,c

Alignments

Saccade_

Trial Types

GOCorrect

NOGOWrong

NorSef_m.356

Pair: 01a, 01b

PSTCH Comparison First Crossing = 322.5 ms

Trial Type: GOCorrect

Number of Trials: 605

Bin Width: 5ms

Coin Width: +/- 50ms

Covariogram Peak: 0.201

Trial Type: NOGOWrong






Number of Trials: 94

Bin Width: 5ms

Coin Width: +/- 50ms

Covariogram Peak: 0.441

PSTCH Comparison

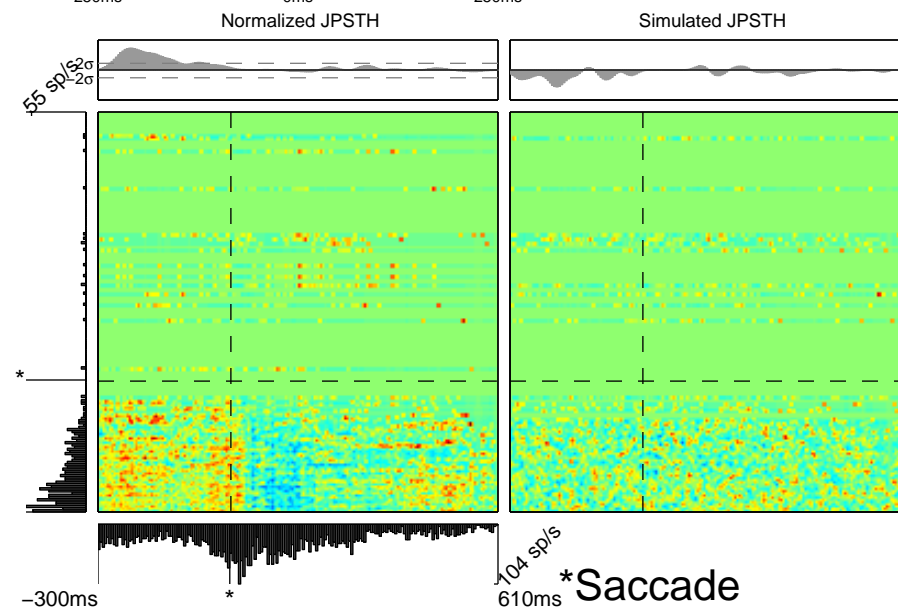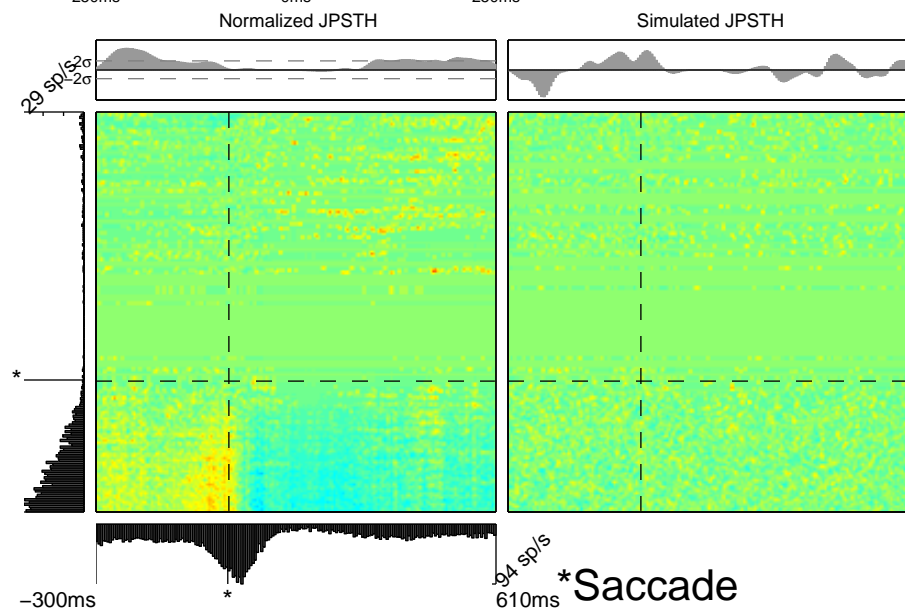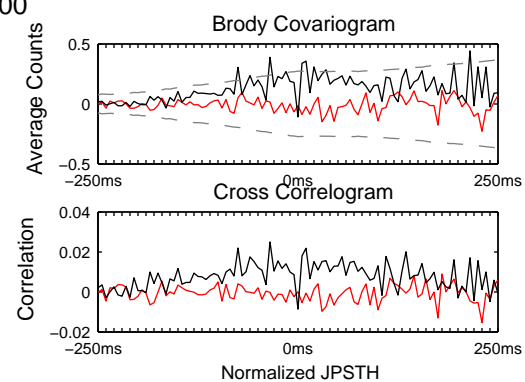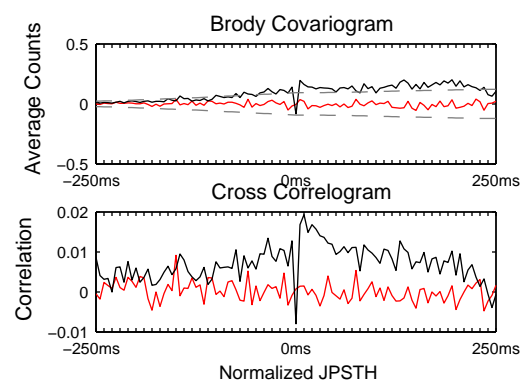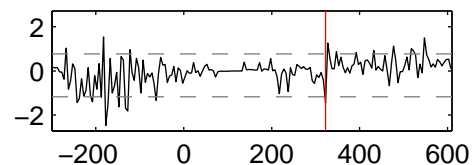


Pair: 01a, 01c

PSTCH Comparison First Crossing = 297.5 ms

Trial Type: GOCorrect
Number of Trials: 605
Bin Width: 5ms
Coin Width: +/- 50ms
Covariogram Peak: 0.0831

Trial Type: NOGOWrong
Number of Trials: 94
Bin Width: 5ms
Coin Width: +/- 50ms
Covariogram Peak: 0.194

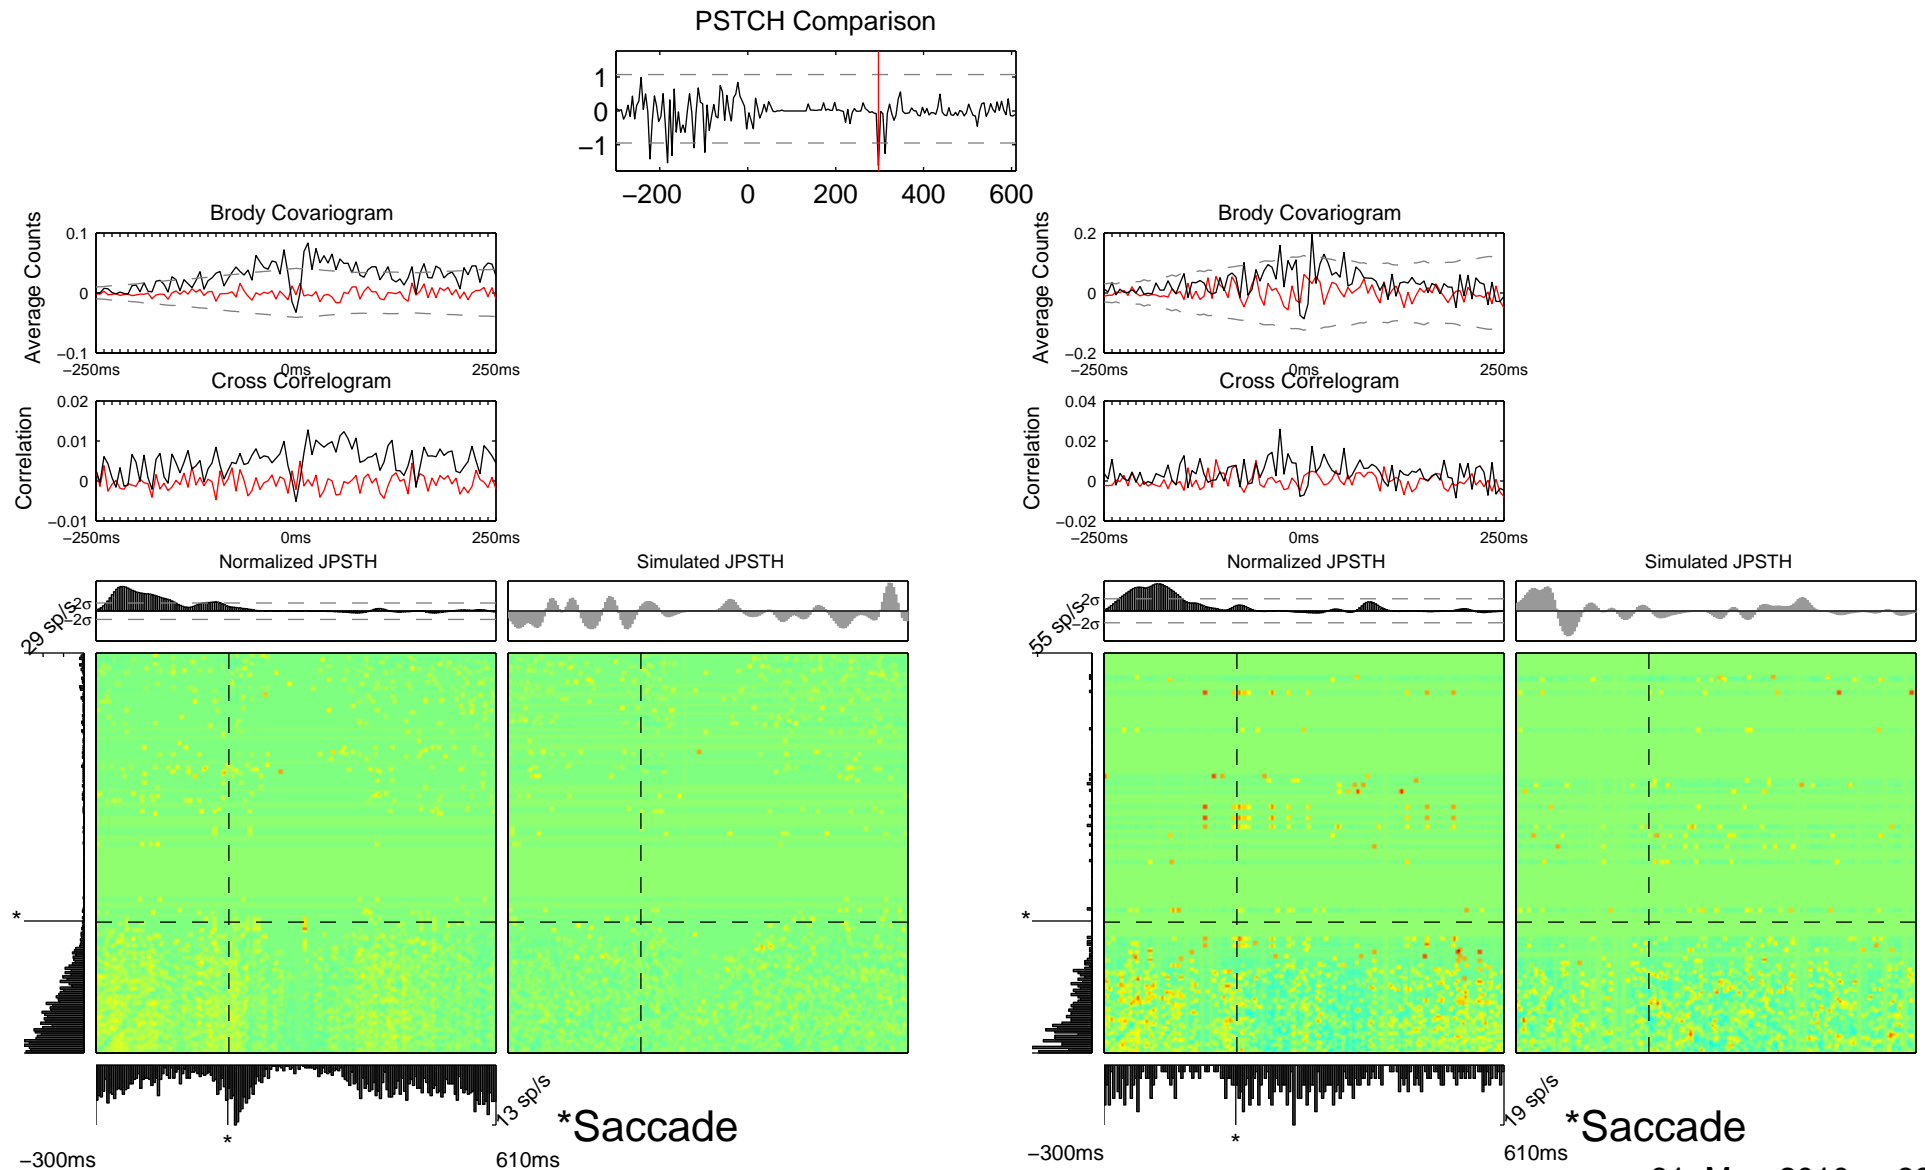

NorSef_m.356
Pair: 01b, 01c

PSTCH Comparison First Crossing = 87.5 ms

Trial Type: GOCorrect
Number of Trials: 605
Bin Width: 5ms
Coin Width: ± 50 ms
Covariogram Peak: 0.302

Trial Type: NOGOWrong
Number of Trials: 94
Bin Width: 5ms
Coin Width: ± 50 ms
Covariogram Peak: 0.507

PSTCH Comparison

