

NorSef_m.731

31-Mar-2010

code revision: 3372

/haitasj/manuscripts/errorMonitoringBySpikeSynchronyInSupplementaryEyeField

Electrodes

DSP01

Units

a,b,c

Alignments

Saccade_

Trial Types

GOCorrect

NOGOWrong






NorSef_m.731
Pair: 01a, 01b

PSTCH Comparison First Crossing = 257.5 ms

Trial Type: GOCorrect
Number of Trials: 329
Bin Width: 5ms
Coin Width: +/- 50ms
Covariogram Peak: 0.052

Trial Type: NOGOWrong
Number of Trials: 44
Bin Width: 5ms
Coin Width: +/- 50ms
Covariogram Peak: 0.254

PSTCH Comparison

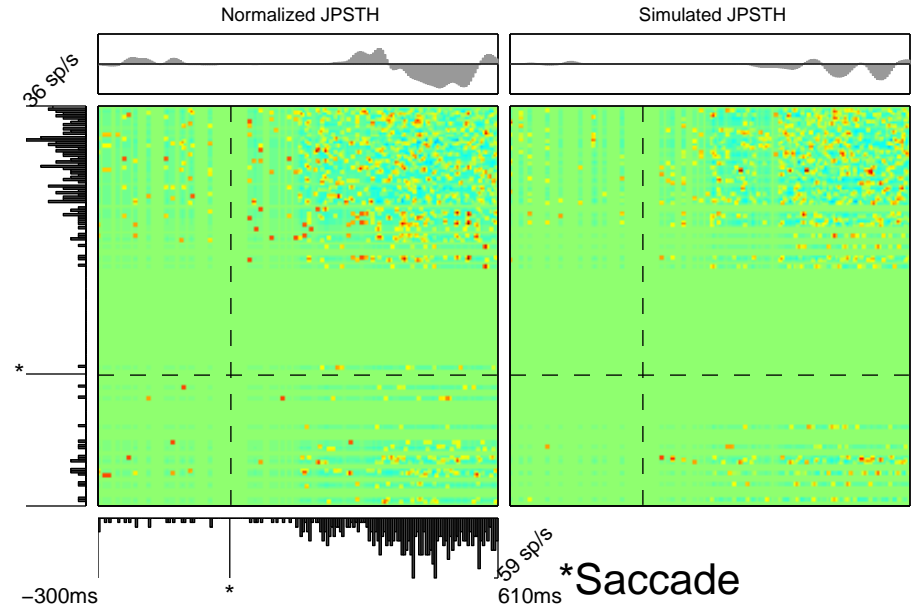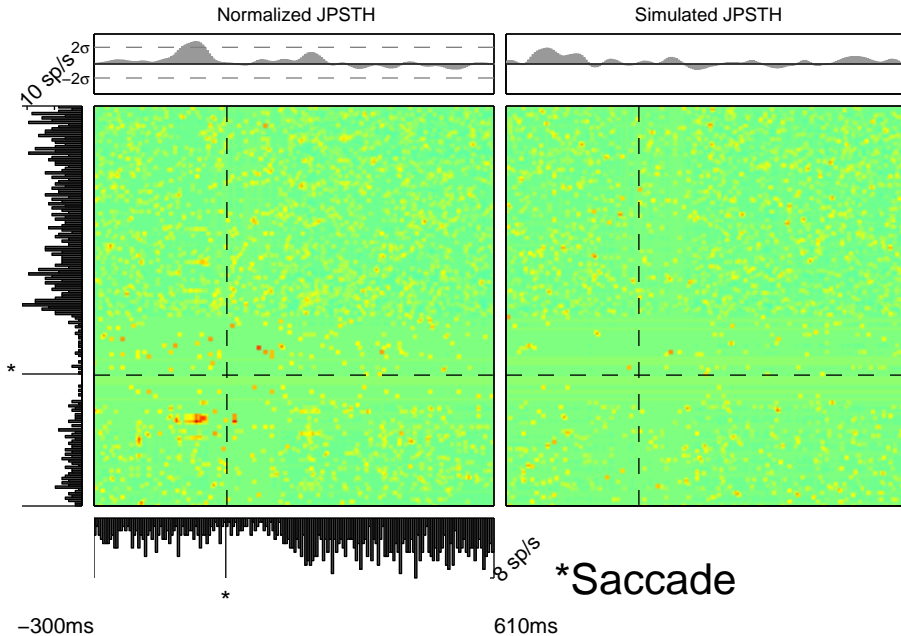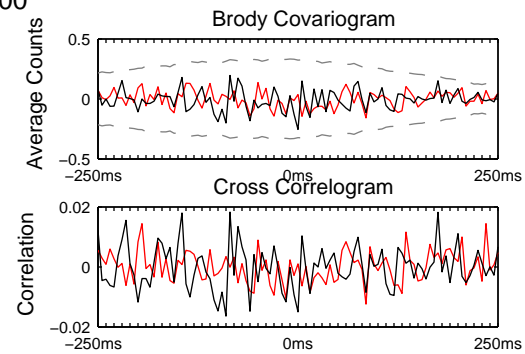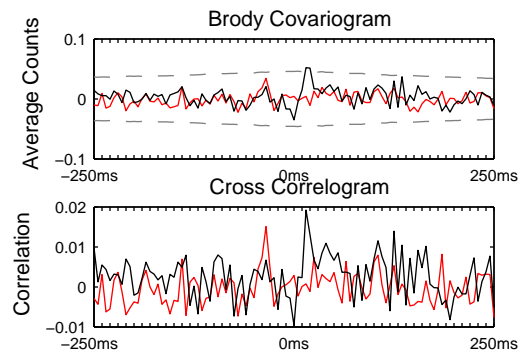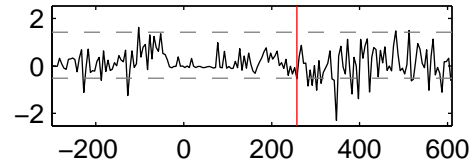






NorSef_m.731
Pair: 01a, 01c

PSTCH Comparison First Crossing = 247.5 ms

Trial Type: GOCorrect
Number of Trials: 329
Bin Width: 5ms
Coin Width: +/- 50ms
Covariogram Peak: 1.06

Trial Type: NOGOWrong
Number of Trials: 44
Bin Width: 5ms
Coin Width: +/- 50ms
Covariogram Peak: 1.51

PSTCH Comparison

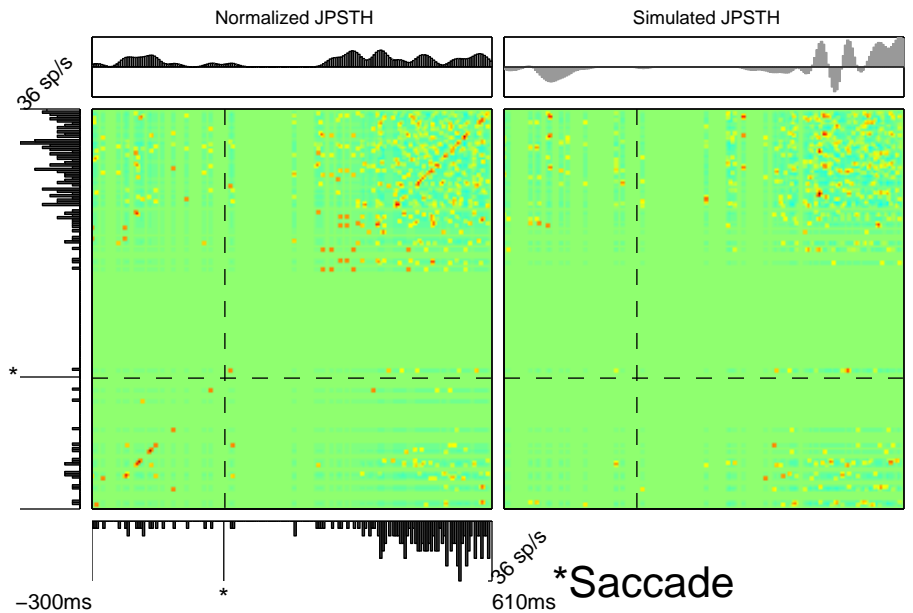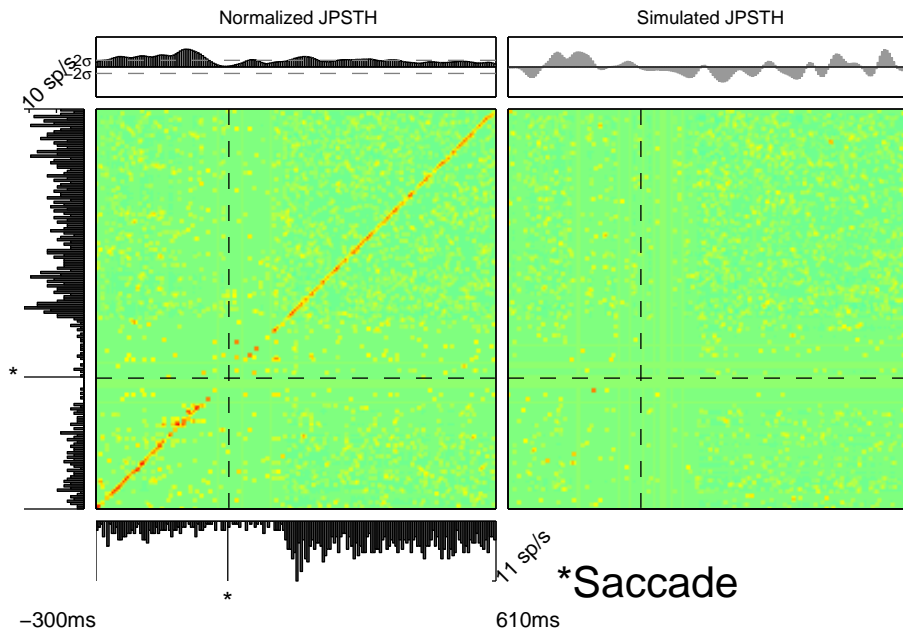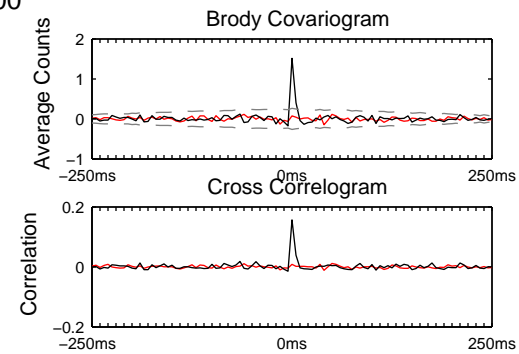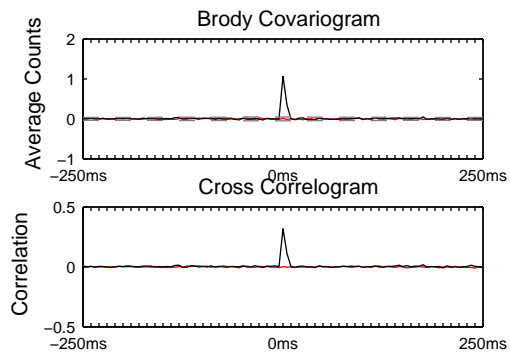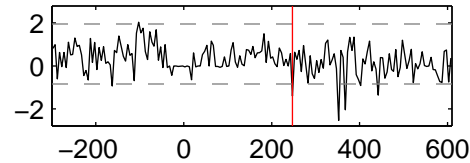

NorSef_m.731
Pair: 01b, 01c

PSTCH Comparison First Crossing = 162.5 ms

Trial Type: GOCorrect
Number of Trials: 329
Bin Width: 5ms
Coin Width: +/- 50ms
Covariogram Peak: 0.515

Trial Type: NOGOWrong
Number of Trials: 44
Bin Width: 5ms
Coin Width: +/- 50ms
Covariogram Peak: 0.67

PSTCH Comparison

